




1866-2016



150th
Anniversary

San Jose Water Company

Report on Water Quality Relative to Public Health Goals

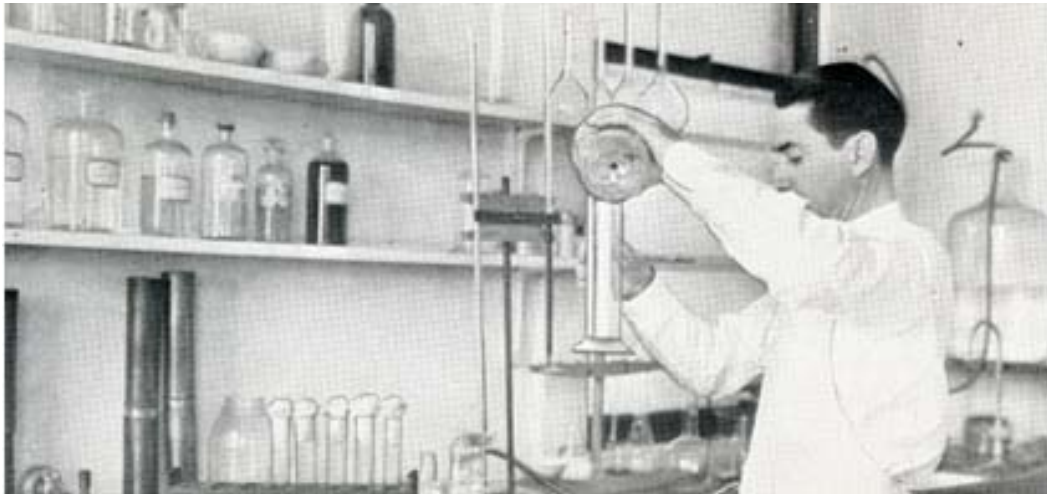

CELEBRATING 150 YEARS OF SERVICE

Published July 2016

**San Jose Water Company
Report on Water Quality Relative to Public Health Goals**

Table of Contents

BACKGROUND.....	2
WHAT ARE PHGS?	2
WATER QUALITY DATA CONSIDERED.....	2
GUIDELINES FOLLOWED.....	3
BEST AVAILABLE TREATMENT TECHNOLOGY AND COST ESTIMATES:.....	3
CONSTITUENTS DETECTED THAT EXCEED A PHG OR A MCLG.....	3
HEXAVALENT CHROMIUM	3
HALOACETIC ACIDS	4
TRIHALOMETHANES	4
COLIFORM BACTERIA.....	5
CONCLUSIONS.....	5

Background

California Health and Safety Code provisions require that water utilities serving more than 10,000 service connections prepare a special report by July 1, 2016 if their water quality measurements on water supplied to consumers have exceeded any Public Health Goals (PHGs). PHGs are non-enforceable goals established by the California Environmental Protection Agency's (Cal-EPA's) Office of Environmental Health Hazard Assessment (OEHHA). They are developed as goals because they are purely health-based objectives and may not be technically or economically feasible to achieve.

The law also requires that where OEHHA has not adopted a PHG for a constituent, the water suppliers are to use the Maximum Contaminant Level Goals (MCLGs) adopted by United States Environmental Protection Agency (USEPA). MCLGs are also non-enforceable, strictly health-based levels. Only constituents which have a California primary drinking water standard (Maximum Contaminant Level or MCL) and for which either a PHG or MCLG has been set by either DDW or USEPA are to be addressed. Attachment No.1 is a list of all regulated constituents and their MCLs and PHGs or MCLGs.

The law specifies what information is to be provided in the report. If a constituent was detected in SJWC's water supply between 2013 and 2015 at a level exceeding an applicable PHG or MCLG, this report provides the information required.

What are PHGs?

PHGs are set by the California Office of Environmental Health Hazard Assessment (OEHHA) which is part of Cal-EPA, and are based solely on public health risk considerations. None of the risk-management factors that are considered by the USEPA or the California State Water Resources Control Board Division of Drinking Water (DDW) in setting drinking water standards are considered in setting the PHGs. These factors include analytical detection capability, treatment technology available, benefits and costs. The PHGs are not enforceable and are not required to be met by any public water system. MCLGs are the federal equivalent to PHGs, but are not identical.

Water Quality Data Considered

All of the water quality data collected by our water system for purposes of determining compliance with drinking water standards during the years 2013, 2014 and 2015 were considered. These data were summarized in our 2013, 2014, and 2015 Annual Water Quality Reports. These reports are made available to all of our customers annually and posted on our website at <http://www.sjwater.com/ccr>.

Most of the constituents are reported as ND or "not detected". This generally means that the laboratory report indicated that the compound was not detected, but it could also mean that it was detected at a level less than the *detection level for purposes of reporting* (DLR). This is a level

above which any analytical finding of a contaminant in drinking water resulting from required monitoring must be reported to DDW.

Guidelines Followed

The Association of California Water Agencies (ACWA) formed a workgroup which prepared guidelines for water utilities to use in preparing these reports. These guidelines were used in the preparation of our report. Health risk information was provided by the Office of Environmental Health Hazard Assessment (OEHHA) (Attachment 2). No other guidance was available from state regulatory agencies.

Best available Treatment Technology and Cost Estimates

Both the USEPA and CDPH adopt what are known as BATs or Best Available Technologies, which are the best known methods of reducing contaminant levels to the MCL. Costs can be estimated for such technologies. However, since many PHGs and all MCLGs are set much lower than the MCL, it is not always feasible to determine what treatment is needed to further reduce a contaminant down to or nearer the PHG or MCLG, many of which are set at zero. Estimating the costs to reduce a contaminant to zero is difficult, if not impossible. Where MCLGs are set at zero, there may not be commercially available technology to reach a non-detectable level. Since there is little data available to estimate cost of treatment to achieve absolute zero levels, rough estimates of “BAT” may be used but implementation of this “BAT” may still not achieve the PHG or MCLG and the costs to do so may be prohibitive.

Constituents Detected that Exceed a PHG or a MCLG

The following is a discussion of constituents that were detected in one or more of SJWC’s drinking water sources during monitoring for years 2013, 2014 and 2015 compliance at levels above the PHG, or above the MCLG if there is no PHG.

Hexavalent Chromium

Chromium is a naturally occurring metal found in soil, rocks, surface water and groundwater. It is a component of steel products and is used in many industrial processes, products and consumer products. In nature, chromium exists in two primary oxidation levels, 6 and 3; Chromium-3 (Cr-3) is an essential nutrient for humans. Chromium-6 (Cr-6) is what is known as hexavalent chromium, which can form easily in the natural environment from oxidation of Cr-3. Cr-6 has been linked to cancer when inhaled or ingested, and skin exposure can lead to rashes.

Chromium-6 in drinking water is primarily found in groundwater wells. California began regulating Cr-6 in July of 2014, and the current PHG for Cr-6 is 0.00002 mg/L. In 2015, three of San Jose Water Company’s groundwater wells produced samples containing Cr-6 above the

California PHG but below the MCL of 0.01 mg/L. San Jose Water Company will continue to sample according to DDW recommendations to ensure the level of Cr-6 does not climb towards the MCL for these wells.

Haloacetic Acids

Five chemicals in the Haloacetic Acid family are currently regulated as drinking water contaminants, commonly referred to as HAA5. These include monochloroacetic acid (MCAA), dichloroacetic acid (DCAA), trichloroacetic acid (TCAA), monobromoacetic acid (MBAA, or bromoacetic acid), and dibromoacetic acid (DBAA). Most haloacetic acids in the environment are created as byproducts of chemical reactions or deliberately synthesized for industrial uses. They are used in fruit harvesting, as pesticides, as bacterial control agents, and in production of chemicals, pharmaceuticals and medications. They are also a byproduct of the chlorination of water for disinfection. They are so widely produced, used and released that they can be found in most surface water and even in rainwater. Haloacetic acids have been linked to cancer and to liver toxicity.

In drinking water, HAA5 are primarily formed during disinfection, and are monitored quarterly by San Jose Water Company in accordance with water quality regulations. SJWC has been in compliance with all state and federal regulations regarding HAA5 throughout 2013, 2014, and 2015. There is no California PHG for individual Haloacetic Acids, so instead the USEPA MCLGs are used for the purposes of this report. The USEPA MCLG for DCAA is 0 mg/L and for TCAA is 0.02 mg/L. Both of these were detected in San Jose Water Company's system above the MCLG in 2015. There is no PHG or MCLG for MBAA, but this was also detected at very low levels in 2015.

Trihalomethanes

Trihalomethanes are another class of chemicals formed during disinfection. Bromodichloromethane (BDCM), dibromochloromethane (DBCM), bromoform and chloroform are currently the trihalomethanes (THMs) of public health concern in drinking water. Trihalomethanes in drinking water are undesirable but are created by unavoidable reactions of chlorine disinfectants with organic materials already in the water. Trihalomethanes have been linked to cancer and to liver, kidney, and nervous system toxicity.

There is no California PHG for individual trihalomethanes, so instead the USEPA MCLGs are used for the purposes of this report. The USEPA MCLGs for BDCM and Bromoform are 0 mg/L, and for Chloroform is 0.07 mg/L. Each of these three chemicals were detected above their USEPA MCLGs in SJWC's distribution system during 2015.

Due to the recent drought in our area, surface water sources have been especially prone to algal blooms, which increases the amount of organic matter dissolved in our source waters. Dissolved organic matter is linked to formation of HAA5 during disinfection. We are working continuously with our source waters and surface water provider to minimize formation of disinfection by-products including THMs and HAA5 through operational adjustments and blending with groundwater low in organic matter.

Coliform Bacteria

The MCL for coliform bacteria was 5% positive samples of all samples per month through March of 31, 2016. The MCLG for E.Coli is zero. The reason for the coliform drinking water standard is to minimize the possibility of the water containing pathogens, which are organisms that cause waterborne disease. Because coliform is only a surrogate indicator of the potential presence of pathogens, it is not possible to state a specific numerical health risk. That is, coliforms are sometimes present due to regrowth or sampling errors, and represent little or no risk to public health. While USEPA normally sets MCLGs “at a level where no known or anticipated adverse effects on persons would occur”, they indicate that they cannot do so with coliforms.

During 2013, 2014 and 2015, SJWC collected between 345 and 475 samples each month for coliform analysis. Occasionally, a sample was found to be positive for coliform bacteria but repeat samples were negative and follow-up actions were taken. A maximum of 3.3% of these samples were positive in any month, with a mean of 0.26% positive for the years of 2013, 2014 and 2015.

Coliform bacteria are indicator organisms that are ubiquitous in nature and are not generally considered harmful. They are used as an indicator because of the ease in monitoring and analysis. If a positive sample is found, it indicates a potential problem that needs to be investigated, which always includes follow-up sampling. It is not at all unusual for a system to have an occasional positive sample due to sampling errors. It is difficult, if not impossible, to assure that a system will never get a positive sample. In addition, due to the sensitive nature of the laboratory analysis method, positive results caused by corrupted samples occur. SJWC maintains a disinfectant residual (chlorine or chloramine) throughout the distribution system to prevent the growth of microbial organisms. Other equally important measures that we have implemented to control bacteria include a comprehensive cross-connection control program, a water main flushing program, an effective monitoring and surveillance program, and maintaining positive pressures in our distribution system. As a result, our system has already taken all of the steps described by CDPH as “best available technology” for coliform bacteria in Section 64447, Title 22, CCR.

Conclusions

The drinking water provided by San Jose Water Company meets all State of California and USEPA drinking water standards set to protect public health. Additional costly treatment processes would be required to further reduce the levels of the constituents identified in this report. The effectiveness of the treatment processes is uncertain. The health protection benefits of these further hypothetical reductions are not at all clear and may not be quantifiable. Therefore, no action is proposed. This assessment is consistent with the recommendations of California Division of Drinking Water.

Attachment No. 1

MCLs, DLRs, and PHGs for Regulated Drinking Water Contaminants**(Units are in milligrams per liter (mg/L), unless otherwise noted.)****Last Update: August 10, 2015**

This table includes:

California's maximum contaminant levels (MCLs)

Detection limits for purposes of reporting (DLRs)

[Public health goals \(PHGs\) from the Office of Environmental Health Hazard Assessment \(OEHHA\)](#)

Also, PHGs for NDMA and 1,2,3-Trichloropropane (which are not yet regulated) are included at the bottom of this table.

	MCL	DLR	PHG	Date of PHG
Chemicals with MCLs in 22 CCR §64431—Inorganic Chemicals				
Aluminum	1	0.05	0.6	2001
Antimony	0.006	0.006	0.02	1997
Antimony	--	--	0.0007	2009 draft
Arsenic	0.010	0.002	0.000004	2004
Asbestos (MFL = million fibers per liter; for fibers >10 microns long)	7 MFL	0.2 MFL	7 MFL	2003
Barium	1	0.1	2	2003
Beryllium	0.004	0.001	0.001	2003
Cadmium	0.005	0.001	0.00004	2006
Chromium, Total - OEHHA withdrew the 0.0025-mg/L PHG	0.05	0.01	withdrawn Nov. 2001	1999
Chromium, Hexavalent	0.010	0.001	0.00002	2011
Cyanide	0.15	0.1	0.15	1997
Fluoride	2	0.1	1	1997
Mercury (inorganic)	0.002	0.001	0.0012	1999 (rev2005)*
Nickel	0.1	0.01	0.012	2001
Nitrate (as nitrogen, N)	10 as N	0.4	45 as NO ₃ (=10 as N)	1997
Nitrite (as N)	1 as N	0.4	1 as N	1997
Nitrate + Nitrite (as N)	10 as N	--	10 as N	1997
Perchlorate	0.006	0.004	0.001	2015
Selenium	0.05	0.005	0.03	2010
Thallium	0.002	0.001	0.0001	1999 (rev2004)
Copper and Lead, 22 CCR §64672.3				
<i>Values referred to as MCLs for lead and copper are not actually MCLs; instead, they are called "Action Levels" under the lead and copper rule</i>				
Copper	1.3	0.05	0.3	2008
Lead	0.015	0.005	0.0002	2009

Radionuclides with MCLs in 22 CCR §64441 and §64443—Radioactivity

[units are picocuries per liter (pCi/L), unless otherwise stated; n/a = not applicable]

Gross alpha particle activity - OEHHA concluded in 2003 that a PHG was not practical	15	3	none	n/a
Gross beta particle activity - OEHHA concluded in 2003 that a PHG was not practical	4 mrem/yr	4	none	n/a
Radium-226	--	1	0.05	2006
Radium-228	--	1	0.019	2006
Radium-226 + Radium-228	5	--	--	--
Strontium-90	8	2	0.35	2006
Tritium	20,000	1,000	400	2006
Uranium	20	1	0.43	2001

Chemicals with MCLs in 22 CCR §64444—Organic Chemicals

(a) Volatile Organic Chemicals (VOCs)

Benzene	0.001	0.0005	0.00015	2001
Carbon tetrachloride	0.0005	0.0005	0.0001	2000
1,2-Dichlorobenzene	0.6	0.0005	0.6	1997 (rev2009)
1,4-Dichlorobenzene (p-DCB)	0.005	0.0005	0.006	1997
1,1-Dichloroethane (1,1-DCA)	0.005	0.0005	0.003	2003
1,2-Dichloroethane (1,2-DCA)	0.0005	0.0005	0.0004	1999 (rev2005)
1,1-Dichloroethylene (1,1-DCE)	0.006	0.0005	0.01	1999
cis-1,2-Dichloroethylene	0.006	0.0005	0.1	2006
trans-1,2-Dichloroethylene	0.01	0.0005	0.06	2006
Dichloromethane (Methylene chloride)	0.005	0.0005	0.004	2000
1,2-Dichloropropane	0.005	0.0005	0.0005	1999
1,3-Dichloropropene	0.0005	0.0005	0.0002	1999 (rev2006)
Ethylbenzene	0.3	0.0005	0.3	1997
Methyl tertiary butyl ether (MTBE)	0.013	0.003	0.013	1999
Monochlorobenzene	0.07	0.0005	0.07	2014
Styrene	0.1	0.0005	0.0005	2010
1,1,2,2-Tetrachloroethane	0.001	0.0005	0.0001	2003
Tetrachloroethylene (PCE)	0.005	0.0005	0.00006	2001
Toluene	0.15	0.0005	0.15	1999
1,2,4-Trichlorobenzene	0.005	0.0005	0.005	1999
1,1,1-Trichloroethane (1,1,1-TCA)	0.2	0.0005	1	2006
1,1,2-Trichloroethane (1,1,2-TCA)	0.005	0.0005	0.0003	2006
Trichloroethylene (TCE)	0.005	0.0005	0.0017	2009
Trichlorofluoromethane (Freon 11)	0.15	0.005	1.3	2014
1,1,2-Trichloro-1,2,2-Trifluoroethane (Freon 113)	1.2	0.01	4	1997 (rev2011)
Vinyl chloride	0.0005	0.0005	0.00005	2000
Xylenes	1.75	0.0005	1.8	1997

(b) Non-Volatile Synthetic Organic Chemicals (SOCs)

Alachlor	0.002	0.001	0.004	1997
Atrazine	0.001	0.0005	0.00015	1999
Bentazon	0.018	0.002	0.2	1999 (rev2009)
Benzo(a)pyrene	0.0002	0.0001	0.000007	2010
Carbofuran	0.018	0.005	0.0017	2000
Chlordane	0.0001	0.0001	0.00003	1997 (rev2006)
Dalapon	0.2	0.01	0.79	1997 (rev2009)
1,2-Dibromo-3-chloropropane (DBCP)	0.0002	0.00001	0.0000017	1999
2,4-Dichlorophenoxyacetic acid (2,4-D)	0.07	0.01	0.02	2009
Di(2-ethylhexyl)adipate	0.4	0.005	0.2	2003
Di(2-ethylhexyl)phthalate (DEHP)	0.004	0.003	0.012	1997
Dinoseb	0.007	0.002	0.014	1997 (rev2010)
Diquat	0.02	0.004	0.015	2000
Endrin	0.002	0.0001	0.0018	1999 (rev2008)
Endothal	0.1	0.045	0.094	2014
Ethylene dibromide (EDB)	0.00005	0.00002	0.00001	2003
Glyphosate	0.7	0.025	0.9	2007
Heptachlor	0.00001	0.00001	0.000008	1999
Heptachlor epoxide	0.00001	0.00001	0.000006	1999
Hexachlorobenzene	0.001	0.0005	0.00003	2003
Hexachlorocyclopentadiene	0.05	0.001	0.002	2014
Lindane	0.0002	0.0002	0.000032	1999 (rev2005)
Methoxychlor	0.03	0.01	0.00009	2010
Molinate	0.02	0.002	0.001	2008
Oxamyl	0.05	0.02	0.026	2009
Pentachlorophenol	0.001	0.0002	0.0003	2009
Picloram	0.5	0.001	0.5	1997
Polychlorinated biphenyls (PCBs)	0.0005	0.0005	0.00009	2007
Simazine	0.004	0.001	0.004	2001
2,4,5-TP (Silvex)	0.05	0.001	0.003	2014
2,3,7,8-TCDD (dioxin)	3×10^{-8}	5×10^{-9}	5×10^{-11}	2010
Thiobencarb	0.07	0.001	0.07	2000
Toxaphene	0.003	0.001	0.00003	2003

Chemicals with MCLs in 22 CCR §64533—Disinfection Byproducts

Total Trihalomethanes	0.080	--	0.0008	2010 draft
Bromodichloromethane	--	0.0010	--	--
Bromoform	--	0.0010	--	--
Chloroform	--	0.0010	--	--
Dibromochloromethane	--	0.0010	--	--
Haloacetic Acids (five) (HAA5)	0.060	--	--	--
Monochloroacetic Acid	--	0.0020	--	--
Dichloroacetic Acid	--	0.0010	--	--

Trichloroacetic Acid	--	0.0010	--	--
Monobromoacetic Acid	--	0.0010	--	--
Dibromoacetic Acid	--	0.0010	--	--
Bromate	0.010	0.0050**	0.0001	2009
Chlorite	1.0	0.020	0.05	2009
<i>Chemicals with PHGs established in response to DDW requests. These are not currently regulated drinking water contaminants.</i>				
N-Nitrosodimethylamine (NDMA)	--	--	0.000003	2006
1,2,3-Trichloropropane	--	--	0.0000007	2009
*OEHHA's review of this chemical during the year indicated (rev20XX) resulted in no change in the PHG.				
**The DLR for Bromate is 0.0010 mg/L for analysis performed using EPA Method 317.0 Revision 2.0, 321.8, or 326.0.				

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category ¹	California PHG (mg/L) ²	Cancer Risk ³ at the PHG	California MCL ⁴ (mg/L)	Cancer Risk at the California MCL
<u>Alachlor</u>	carcinogenicity (causes cancer)	0.004	NA ⁵	0.002	NA
<u>Aluminum</u>	neurotoxicity and immunotoxicity (harms the nervous and immune systems)	0.6	NA	1	NA
<u>Antimony</u>	digestive system toxicity (causes vomiting)	0.02	NA	0.006	NA
<u>Arsenic</u>	carcinogenicity (causes cancer)	0.000004 (4×10 ⁻⁶)	1×10 ⁻⁶ (one per million)	0.01	2.5×10 ⁻³ (2.5 per thousand)
<u>Asbestos</u>	carcinogenicity (causes cancer)	7 MFL ⁶ (fibers >10 microns in length)	1×10 ⁻⁶	7 MFL (fibers >10 microns in length)	1×10 ⁻⁶ (one per million)
<u>Atrazine</u>	carcinogenicity (causes cancer)	0.00015	1×10 ⁻⁶	0.001	7×10 ⁻⁶ (seven per million)

¹ Based on the OEHHA PHG technical support document unless otherwise specified. The categories are the hazard traits defined by OEHHA for California's Toxics Information Clearinghouse (online at: http://oehha.ca.gov/multimedia/green/pdf/GC_Regtext011912.pdf).

² mg/L = milligrams per liter of water or parts per million (ppm)

³ Cancer Risk = Upper estimate of excess cancer risk from lifetime exposure. Actual cancer risk may be lower or zero. 1×10⁻⁶ means one excess cancer case per million people exposed.

⁴ MCL = maximum contaminant level.

⁵ NA = not applicable. Risk cannot be calculated. The PHG is set at a level that is believed to be without any significant public health risk to individuals exposed to the chemical over a lifetime.

⁶ MFL = million fibers per liter of water.

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>Barium</u>	cardiovascular toxicity (causes high blood pressure)	2	NA	1	NA
<u>Bentazon</u>	hepatotoxicity and digestive system toxicity (harms the liver, intestine, and causes body weight effects ⁷)	0.2	NA	0.018	NA
<u>Benzene</u>	carcinogenicity (causes leukemia)	0.00015	1×10^{-6}	0.001	7×10^{-6} (seven per million)
<u>Benzo[a]pyrene</u>	carcinogenicity (causes cancer)	0.000007 (7×10^{-6})	1×10^{-6}	0.0002	3×10^{-5} (three per hundred thousand)
<u>Beryllium</u>	digestive system toxicity (harms the stomach or intestine)	0.001	NA	0.004	NA
<u>Bromate</u>	carcinogenicity (causes cancer)	0.0001	1×10^{-6}	0.01	1×10^{-4} (one per ten thousand)
<u>Cadmium</u>	nephrotoxicity (harms the kidney)	0.00004	NA	0.005	NA
<u>Carbofuran</u>	reproductive toxicity (harms the testis)	0.0017	NA	0.018	NA

⁷ Body weight effects are an indicator of general toxicity in animal studies.

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>Carbon tetrachloride</u>	carcinogenicity (causes cancer)	0.0001	1×10^{-6}	0.0005	5×10^{-6} (five per million)
<u>Chlordane</u>	carcinogenicity (causes cancer)	0.00003	1×10^{-6}	0.0001	3×10^{-6} (three per million)
<u>Chlorite</u>	hematotoxicity (causes anemia) neurotoxicity (causes neurobehavioral effects)	0.05	NA	1	NA
<u>Chromium, hexavalent</u>	carcinogenicity (causes cancer)	0.00002	1×10^{-6}	0.01	5×10^{-4} (five per ten thousand)
<u>Copper</u>	digestive system toxicity (causes nausea, vomiting, diarrhea)	0.3	NA	1.3 (AL ⁸)	NA
<u>Cyanide</u>	neurotoxicity (damages nerves) endocrine toxicity (affects the thyroid)	0.15	NA	0.15	NA
<u>Dalapon</u>	nephrotoxicity (harms the kidney)	0.79	NA	0.2	NA

⁸ AL = action level. The action levels for copper and lead refer to a concentration measured at the tap. Much of the copper and lead in drinking water is derived from household plumbing (The Lead and Copper Rule, Title 22, California Code of Regulations [CCR] section 64672.3).

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>1,2-Dibromo-3-chloropropane (DBCP)</u>	carcinogenicity (causes cancer)	0.0000017 (1.7×10 ⁻⁶)	1×10 ⁻⁶	0.0002	1×10 ⁻⁴ (one per ten thousand)
<u>1,2-Dichlorobenzene (o-DCB)</u>	hepatotoxicity (harms the liver)	0.6	NA	0.6	NA
<u>1,4-Dichlorobenzene (p-DCB)</u>	carcinogenicity (causes cancer)	0.006	1×10 ⁻⁶	0.005	8×10 ⁻⁷ (eight per ten million)
<u>1,1-Dichloroethane (1,1-DCA)</u>	carcinogenicity (causes cancer)	0.003	1×10 ⁻⁶	0.005	2×10 ⁻⁶ (two per million)
<u>1,2-Dichloroethane (1,2-DCA)</u>	carcinogenicity (causes cancer)	0.0004	1×10 ⁻⁶	0.0005	1×10 ⁻⁶ (one per million)
<u>1,1-Dichloroethylene (1,1-DCE)</u>	hepatotoxicity (harms the liver)	0.01	NA	0.006	NA
<u>1,2-Dichloroethylene, cis</u>	nephrotoxicity (harms the kidney)	0.1	NA	0.006	NA
<u>1,2-Dichloroethylene, trans</u>	hepatotoxicity (harms the liver)	0.06	NA	0.01	NA
<u>Dichloromethane (methylene chloride)</u>	carcinogenicity (causes cancer)	0.004	1×10 ⁻⁶	0.005	1×10 ⁻⁶ (one per million)
<u>2,4-Dichlorophenoxyacetic acid (2,4-D)</u>	hepatotoxicity and nephrotoxicity (harms the liver and kidney)	0.02	NA	0.07	NA

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category ¹	California PHG (mg/L) ²	Cancer Risk ³ at the PHG	California MCL ⁴ (mg/L)	Cancer Risk at the California MCL
<u>1,2-Dichloro-propane (propylene dichloride)</u>	carcinogenicity (causes cancer)	0.0005	1×10^{-6}	0.005	1×10^{-5} (one per hundred thousand)
<u>1,3-Dichloro-propene (Telone II®)</u>	carcinogenicity (causes cancer)	0.0002	1×10^{-6}	0.0005	2×10^{-6} (two per million)
<u>Di(2-ethylhexyl) adipate (DEHA)</u>	developmental toxicity (disrupts development)	0.2	NA	0.4	NA
<u>Diethylhexyl-phthalate (DEHP)</u>	carcinogenicity (causes cancer)	0.012	1×10^{-6}	0.004	3×10^{-7} (three per ten million)
<u>Dinoseb</u>	reproductive toxicity (harms the uterus and testis)	0.014	NA	0.007	NA
<u>Dioxin (2,3,7,8-TCDD)</u>	carcinogenicity (causes cancer)	5×10^{-11}	1×10^{-6}	3×10^{-8}	6×10^{-4} (six per ten thousand)
<u>Diquat</u>	ocular toxicity (harms the eye) developmental toxicity (causes malformation)	0.015	NA	0.02	NA
<u>Endothall</u>	digestive system toxicity (harms the stomach or intestine)	0.094	NA	0.1	NA
<u>Endrin</u>	hepatotoxicity (harms the liver) neurotoxicity (causes convulsions)	0.0018	NA	0.002	NA

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>Ethylbenzene (phenylethane)</u>	hepatotoxicity (harms the liver)	0.3	NA	0.3	NA
<u>Ethylene dibromide</u>	carcinogenicity (causes cancer)	0.00001	1×10^{-6}	0.00005	5×10^{-6} (five per million)
<u>Fluoride</u>	musculoskeletal toxicity (causes tooth mottling)	1	NA	2	NA
<u>Glyphosate</u>	nephrotoxicity (harms the kidney)	0.9	NA	0.7	NA
<u>Heptachlor</u>	carcinogenicity (causes cancer)	0.000008 (8×10^{-6})	1×10^{-6}	0.00001	1×10^{-6} (one per million)
<u>Heptachlor epoxide</u>	carcinogenicity (causes cancer)	0.000006 (6×10^{-6})	1×10^{-6}	0.00001	2×10^{-6} (two per million)
<u>Hexachlorobenzene</u>	carcinogenicity (causes cancer)	0.00003	1×10^{-6}	0.001	3×10^{-5} (three per hundred thousand)
<u>Hexachloro-cyclopentadiene (HCCPD)</u>	digestive system toxicity (causes stomach lesions)	0.002	NA	0.05	NA
<u>Lead</u>	developmental neurotoxicity (causes neurobehavioral effects in children) cardiovascular toxicity (causes high blood pressure) carcinogenicity (causes cancer)	0.0002	$<1 \times 10^{-6}$ (PHG is not based on this effect)	0.015 (AL ⁸)	2×10^{-6} (two per million)

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>Lindane</u> (<u>γ-BHC</u>)	carcinogenicity (causes cancer)	0.000032	1×10 ⁻⁶	0.0002	6×10 ⁻⁶ (six per million)
<u>Mercury</u> (<u>inorganic</u>)	nephrotoxicity (harms the kidney)	0.0012	NA	0.002	NA
<u>Methoxychlor</u>	endocrine toxicity (causes hormone effects)	0.00009	NA	0.03	NA
<u>Methyl tertiary-butyl ether</u> (<u>MTBE</u>)	carcinogenicity (causes cancer)	0.013	1×10 ⁻⁶	0.013	1×10 ⁻⁶ (one per million)
<u>Molinate</u>	carcinogenicity (causes cancer)	0.001	1×10 ⁻⁶	0.02	2×10 ⁻⁵ (two per hundred thousand)
<u>Monochloro-benzene</u> (<u>chlorobenzene</u>)	nephrotoxicity (harms the kidney)	0.07	NA	0.07	NA
<u>Nickel</u>	developmental toxicity (causes increased neonatal deaths)	0.012	NA	0.1	NA
<u>Nitrate</u>	hematotoxicity (causes methemoglobinemia)	45 as nitrate	NA	10 as nitrogen (=45 as nitrate)	NA
<u>Nitrite</u>	hematotoxicity (causes methemoglobinemia)	1 as nitrogen	NA	1 as nitrogen	NA

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>Nitrate and Nitrite</u>	hematotoxicity (causes methemoglobinemia)	10 as nitrogen	NA	10 as nitrogen	NA
<u>N-nitroso-dimethyl-amine (NDMA)</u>	carcinogenicity (causes cancer)	0.000003 (3×10 ⁻⁶)	1×10 ⁻⁶	none	NA
<u>Oxamyl</u>	general toxicity (causes body weight effects)	0.026	NA	0.05	NA
<u>Pentachloro-phenol (PCP)</u>	carcinogenicity (causes cancer)	0.0003	1×10 ⁻⁶	0.001	3×10 ⁻⁶ (three per million)
<u>Perchlorate</u>	endocrine toxicity (affects the thyroid) developmental toxicity (causes neurodevelopmental deficits)	0.001	NA	0.006	NA
<u>Picloram</u>	hepatotoxicity (harms the liver)	0.5	NA	0.5	NA
<u>Polychlorinated biphenyls (PCBs)</u>	carcinogenicity (causes cancer)	0.00009	1×10 ⁻⁶	0.0005	6×10 ⁻⁶ (six per million)
<u>Radium-226</u>	carcinogenicity (causes cancer)	0.05 pCi/L	1×10 ⁻⁶	5 pCi/L (combined Ra ²²⁶⁺²²⁸)	1×10 ⁻⁴ (one per ten thousand)
<u>Radium-228</u>	carcinogenicity (causes cancer)	0.019 pCi/L	1×10 ⁻⁶	5 pCi/L (combined Ra ²²⁶⁺²²⁸)	3×10 ⁻⁴ (three per ten thousand)

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>Selenium</u>	integumentary toxicity (causes hair loss and nail damage)	0.03	NA	0.05	NA
<u>Silvex (2,4,5-TP)</u>	hepatotoxicity (harms the liver)	0.003	NA	0.05	NA
<u>Simazine</u>	general toxicity (causes body weight effects)	0.004	NA	0.004	NA
<u>Strontium-90</u>	carcinogenicity (causes cancer)	0.35 pCi/L	1×10^{-6}	8 pCi/L	2×10^{-5} (two per hundred thousand)
<u>Styrene (vinylbenzene)</u>	carcinogenicity (causes cancer)	0.0005	1×10^{-6}	0.1	2×10^{-4} (two per ten thousand)
<u>1,1,2,2-Tetrachloroethane</u>	carcinogenicity (causes cancer)	0.0001	1×10^{-6}	0.001	1×10^{-5} (one per hundred thousand)
<u>Tetrachloroethylene (perchloroethylene, or PCE)</u>	carcinogenicity (causes cancer)	0.00006	1×10^{-6}	0.005	8×10^{-5} (eight per hundred thousand)
<u>Thallium</u>	integumentary toxicity (causes hair loss)	0.0001	NA	0.002	NA
<u>Thiobencarb</u>	general toxicity (causes body weight effects) hematotoxicity (affects red blood cells)	0.07	NA	0.07	NA

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category ¹	California PHG (mg/L) ²	Cancer Risk ³ at the PHG	California MCL ⁴ (mg/L)	Cancer Risk at the California MCL
<u>Toluene (methylbenzene)</u>	hepatotoxicity (harms the liver) endocrine toxicity (harms the thymus)	0.15	NA	0.15	NA
<u>Toxaphene</u>	carcinogenicity (causes cancer)	0.00003	1×10^{-6}	0.003	1×10^{-4} (one per ten thousand)
<u>1,2,4-Trichlorobenzene</u>	endocrine toxicity (harms adrenal glands)	0.005	NA	0.005	NA
<u>1,1,1-Trichloroethane</u>	neurotoxicity (harms the nervous system), reproductive toxicity (causes fewer offspring) hepatotoxicity (harms the liver) hematotoxicity (causes blood effects)	1	NA	0.2	NA
<u>1,1,2-Trichloroethane</u>	carcinogenicity (causes cancer)	0.0003	1×10^{-6}	0.005	2×10^{-5} (two per hundred thousand)
<u>Trichloroethylene (TCE)</u>	carcinogenicity (causes cancer)	0.0017	1×10^{-6}	0.005	3×10^{-6} (three per million)
<u>Trichlorofluoromethane (Freon 11)</u>	accelerated mortality (increase in early death)	1.3	NA	0.15	NA

Table 1: Health Risk Categories and Cancer Risk Values for Chemicals with California Public Health Goals (PHGs)

Chemical	Health Risk Category¹	California PHG (mg/L)²	Cancer Risk³ at the PHG	California MCL⁴ (mg/L)	Cancer Risk at the California MCL
<u>1,2,3-Trichloro-propane</u> (1,2,3-TCP)	carcinogenicity (causes cancer)	0.0000007 (7×10^{-7})	1×10^{-6}	none	NA
<u>1,1,2-Trichloro-1,2,2-trifluoro-ethane</u> (Freon 113)	hepatotoxicity (harms the liver)	4	NA	1.2	NA
<u>Tritium</u>	carcinogenicity (causes cancer)	400 pCi/L	1×10^{-6}	20,000 pCi/L	5×10^{-5} (five per hundred thousand)
<u>Uranium</u>	carcinogenicity (causes cancer)	0.43 pCi/L	1×10^{-6}	20 pCi/L	5×10^{-5} (five per hundred thousand)
<u>Vinyl chloride</u>	carcinogenicity (causes cancer)	0.00005	1×10^{-6}	0.0005	1×10^{-5} (one per hundred thousand)
<u>Xylene</u>	neurotoxicity (affects the senses, mood, and motor control)	1.8 (single isomer or sum of isomers)	NA	1.75 (single isomer or sum of isomers)	NA

Table 2: Health Risk Categories and Cancer Risk Values for Chemicals without California Public Health Goals

Chemical	Health Risk Category ¹	U.S. EPA MCLG ² (mg/L)	Cancer Risk ³ @ MCLG	California MCL ⁴ (mg/L)	Cancer Risk @ California MCL
Disinfection byproducts (DBPS)					
Chloramines	acute toxicity (causes irritation) digestive system toxicity (harms the stomach) hematotoxicity (causes anemia)	4 ^{5,6}	NA ⁷	none	NA
Chlorine	acute toxicity (causes irritation) digestive system toxicity (harms the stomach)	4 ^{5,6}	NA	none	NA
Chlorine dioxide	hematotoxicity (causes anemia) neurotoxicity (harms the nervous system)	0.8 ^{5,6}	NA	none	NA
Disinfection byproducts: haloacetic acids (HAA5)					
Chloroacetic acid	general toxicity (causes body and organ weight changes ⁸)	0.07	NA	none	NA

¹ Health risk category based on the U.S. EPA MCLG document or California MCL document unless otherwise specified.

² MCLG = maximum contaminant level goal established by U.S. EPA.

³ Cancer Risk = Upper estimate of excess cancer risk from lifetime exposure. Actual cancer risk may be lower or zero. 1×10^{-6} means one excess cancer case per million people exposed.

⁴ California MCL = maximum contaminant level established by California.

⁵ Maximum Residual Disinfectant Level Goal, or MRDLG.

⁶ The federal Maximum Residual Disinfectant Level (MRDL), or highest level of disinfectant allowed in drinking water, is the same value for this chemical.

⁷ NA = not available.

⁸ Body weight effects are an indicator of general toxicity in animal studies.

Table 2: Health Risk Categories and Cancer Risk Values for Chemicals without California Public Health Goals

Chemical	Health Risk Category¹	U.S. EPA MCLG² (mg/L)	Cancer Risk³ @ MCLG	California MCL⁴ (mg/L)	Cancer Risk @ California MCL
Dichloroacetic acid	carcinogenicity (causes cancer)	0	0	none	NA
Trichloroacetic acid	hepatotoxicity (harms the liver)	0.02	0	none	NA
Bromoacetic acid	NA	none	NA	none	NA
Dibromoacetic acid	NA	none	NA	none	NA
Total haloacetic acids	carcinogenicity (causes cancer)	none	NA	0.06	NA
Disinfection byproducts: trihalomethanes (THMs)					
Bromodichloromethane (BDCM)	carcinogenicity (causes cancer)	0	0	none	NA
Bromoform	carcinogenicity (causes cancer)	0	0	none	NA
Chloroform	hepatotoxicity and nephrotoxicity (harms the liver and kidney)	0.07	NA	none	NA
Dibromochloromethane (DBCM)	hepatotoxicity, nephrotoxicity, and neurotoxicity (harms the liver, kidney, and nervous system)	0.06	NA	none	NA
Total trihalomethanes (sum of BDCM, bromoform, chloroform and DBCM)	carcinogenicity (causes cancer), hepatotoxicity, nephrotoxicity, and neurotoxicity (harms the liver, kidney, and nervous system)	none	NA	0.08	NA

Table 2: Health Risk Categories and Cancer Risk Values for Chemicals without California Public Health Goals

Chemical	Health Risk Category ¹	U.S. EPA MCLG ² (mg/L)	Cancer Risk ³ @ MCLG	California MCL ⁴ (mg/L)	Cancer Risk @ California MCL
Radionuclides					
Gross alpha particles ⁹	carcinogenicity (causes cancer)	0 (²¹⁰ Po included)	0	15 pCi/L ¹⁰ (includes ²²⁶ Ra but not radon and uranium)	up to 1x10 ⁻³ (for ²¹⁰ Po, the most potent alpha emitter)
Beta particles and photon emitters ⁹	carcinogenicity (causes cancer)	0 (²¹⁰ Pb included)	0	50 pCi/L (judged equiv. to 4 mrem/yr)	up to 2x10 ⁻³ (for ²¹⁰ Pb, the most potent beta-emitter)

⁹ MCLs for gross alpha and beta particles are screening standards for a group of radionuclides. Corresponding PHGs were not developed for gross alpha and beta particles. See the OEHHA memoranda discussing the cancer risks at these MCLs at <http://oehha.studio-weeren.com/media/downloads/water/chemicals/phg/grossalphahealth.pdf>.

¹⁰ pCi/L = picocuries per liter of water.